



## Networking the PT-100 with Other Network Devices (Daisy Chain Configuration)

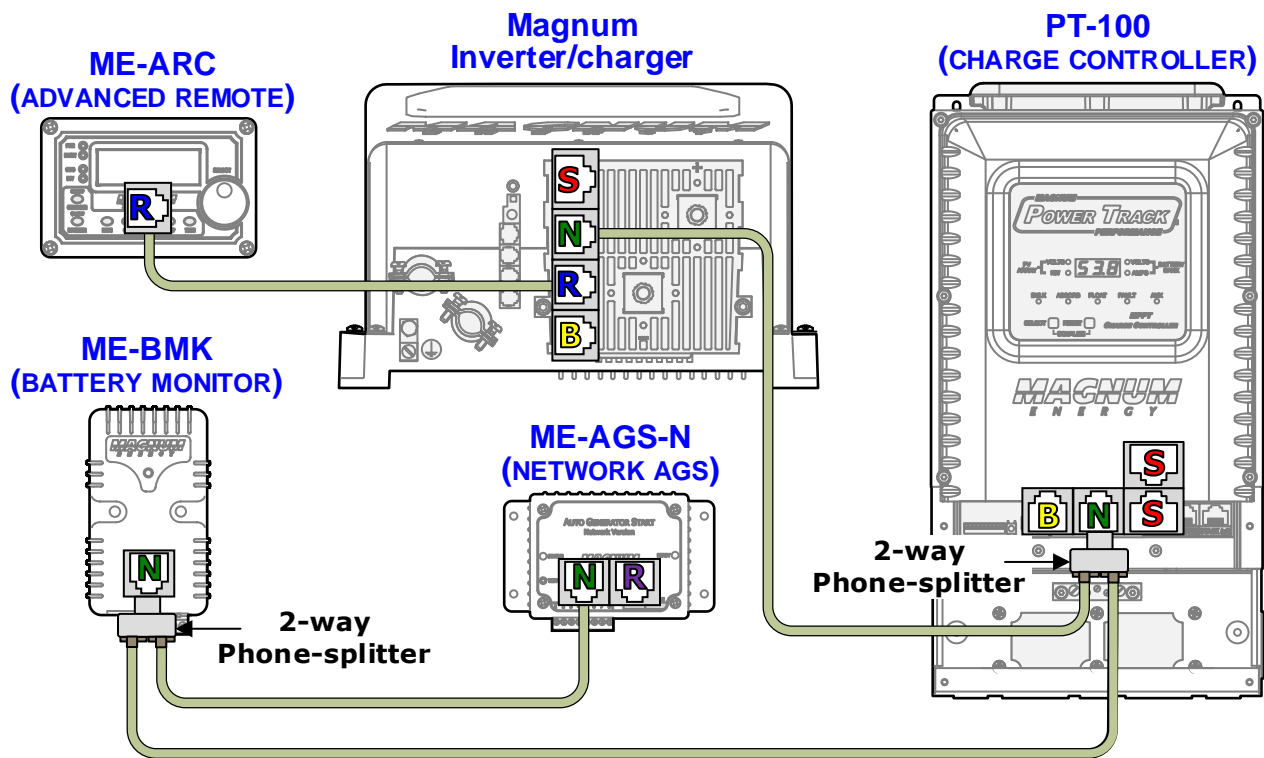

Note: The ME-AGS-N or PT-100 must be the first network device connected to the inverter, followed by the ME-BMK, and whatever device wasn't used as the first network device (ME-AGS-N or PT-100) is connected after the ME-BMK.

## Networking the PT-100 with Other Network Devices (Star with Daisy Chain Configuration)

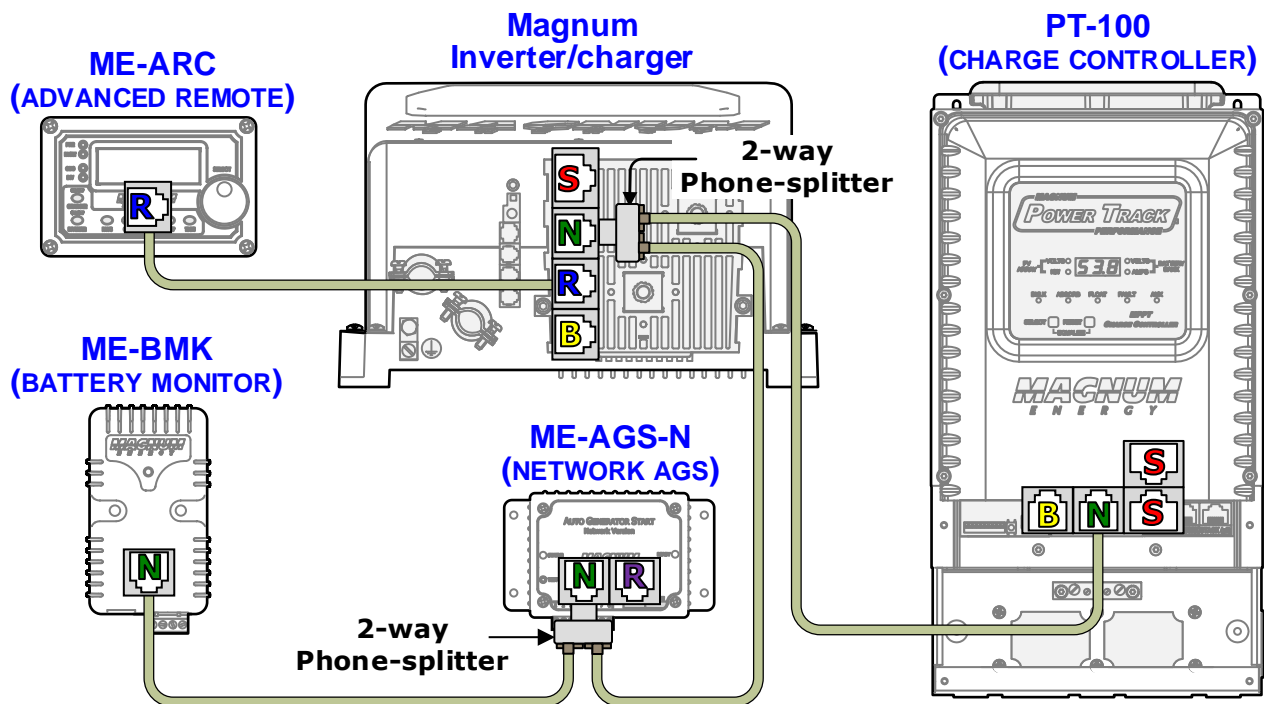

Note: The ME-AGS-N and PT-100 are the first network devices connected to the inverter, followed by the ME-BMK.